



SELF TESTING MAINTAINED EMERGENCY LUMINAIRIES WITH LEDS



TECHNICAL CHARACTERISTICS (for LED MODULE Specs. see page 3)								
	LLB-26/90	LLB-26/180	LLB-40/90	LLB-40/180	LLB-64/90	LLB-64/180		
OPERATION VOLTAGE	220-240V AC/50-60Hz							
MAXIMUM POWER CONSUMPTION	6W/6.4VA	(PF=0.94)	7W/7.4VA	(PF=0.94)	9.3W/9.8VA	A (PF=0.94)		
BATTERY (Ni-MH)	4.8V/	1.2Ah	4.8V/1.2Ah	4.8V/2.4Ah	4.8V/2Ah	4.8V/4Ah		
BATTERY PROTECTION	From overcharge and deep discharge							
INDICATIONS - CONTROLS	Charge LED, Lamp fault LED, Battery Fault LED, TEST button							
CHARGING TIME	24 h							
MINIMUM AUTONOMOUS DURATION	90 min	180 min	90 min	180 min	90 min	180 min		
ILLUMINATION SOURCE	White LEDs							
LIGHT SOURCE INTENSITY (Mains/emerg.)	230lm / 300lm   230lm / 123lm   370lm / 300lm   600lm / 500lm		/ 500lm					
DEGREES OF COVER PROTECTION	IP 44							
PRODUCED IN ACCORDANCE WITH	EN 60598-1, EN 60598-2-22, EN 55015, EN 61547, EN 61000-3-2, EN 61000-3-3, EN 1838							
OPERATION TEMPERATURE RANGE	5 to 40 °C							
RELATIVE HUMIDITY	Up to 95%							
VIEWING DISTANCE	26m		40m		64m			
CONSTRUCTION MATERIALS	Aluminum, ABS/PC, PC, Plexiglass							
EXTERNAL DIMENSIONS (LxHxW)	287 x 205 x 55 mm		435 x 280 x 55 mm		673 x 400 x 55 mm			
TYPICAL WEIGHT	876gr.		1396gr.	1503gr.	1650gr.	2777gr.		
GUARANTEE	3 years (1 year for the battery)							

# Thank you for your trust in our products Olympia Electronics - European manufacturer

#### **GENERAL**

These luminaires are used in places where emergency luminaires are needed. Each luminaire must be permanently connected to mains power supply. In normal operation the led strip lights and the battery is charging. In case of a mains power supply failure the luminaire will light the led strip automatically in emergency mode. When the mains power supply is restored the device turns to normal operation.

# OPERATION Battery Charging

The battery charging is completely controlled by microprocessor and is protected from completely discharge and over charge.

## **Battery Cut-off**

The luminaire enters in this operation when the mains power supply fails and battery has lost its energy. During this operation the luminaire enters the idle state and battery consumption is negligible, in order to be protected from

deep discharge.

#### Manual Test

By pressing the test button briefly (less than 5 seconds) an emergency operation test is performed. The white LEDs will be lit for approx. 3 seconds, the red LED will flash during this test sequence.

#### **Automatic Operational Test**

This test includes all the operations that provide the manual test and is conducted automatically every 15 days. In order to be performed, the mains power supply and the battery should be connected.

#### Manual Autonomous Test

By pressing the test button for between 5 and 10 seconds a battery condition test is performed. This test will last for the stated duration and can only be performed when the battery is fully charged (steady green LED). The white LEDs will be lit and the red LED will flash during this test sequence.

#### **Automatic Autonomous Test**

The Automatic Autonomous Test measures

Page 1 from 6 923064003 09 003

the device's back up operation and emergency duration. This test is conducted automatically every 6 months. In order to be performed, the mains power supply and the battery should be connected and fully charged. If the battery is not fully charged, the test is postponed until the battery is completely charged. If during this test, the autonomy is less than the nominal then the battery fault led will turn on continuously and the battery must be replaced.

#### **Back Up Operation**

The autonomous duration of battery during emergency mode is at least the one that is stated in the list of the technical characteristics. During emergency mode, a light source test is also performed.

## **Resetting Errors**

Push the test button for >10 seconds to delete all indicated errors. Then the luminaire enters regular operation mode.

#### INSTALLATION

To install the luminaire follow the installation instructions on page 3.

#### ATTENTION!!!

- 1. Operations for installation, maintainance or testing must be done by authorized personnel only.
- 2. The device must be connected to the mains power supply through a fuse dependent by the total amount of the line's power load.
- 3. In case of battery or lamp replacement, these must be replaced by parts of the same type, by the manufacturer or by a competent person.
- 4. In case of inactive use for a period greater than 2 months, disconnect the battery by pulling out the battery's connector.
- 5. It is not allowed to discard batteries into common trash bins, they must be discarded only in battery recycling points. Do not incinerate.




The light source contained in this luminaire shall only be replaced by the manufacturer, or his agent, or a similar qualified person.

NOTE! The light source is non-user replaceable.

#### Connection to module

This luminary can be connected to any of the following modules: Remote module, address module and fault relay module. If you connect it to a module that supports inhibit or rest mode, you should know that these commands can be cancelled only during normal mode (ie. not in emergency). You can also refer to the user manual of each module for additional information. The picture bellow shows the installation of the optional module.



Picture 1

Indicator LEDs	Description
©GREEN ORED ORED	Battery charged no faults
-\doc{\doc{\doc{\doc{\doc{\doc{\doc{	Charging (battery test not possible while charging)
0 0 0	Mains off, battery not connected or charger fault
O O -\bar{\pi}-	Battery test
$\emptyset$ $\bigcirc$ $\emptyset$	Battery fault
O -₩́- O	Light source test
	Light source fault
<b>Ø Ø Ø</b>	Battery fault and light source fault

Led status explanation

Off On On - Flashing


Page 2 from 6 923064003\_09\_003

#### INSTALLATION INSTRUCTIONS

#### **ELECTRICAL CONNECTIONS (after the mains interruption)**

- ① Unfasten the two side cover screws and remove the plastic cap by sliding it gently. Install the gasket and make a hole in the center by using a small screwdriver. Pass the round cable through the gasket.
- ② Connect the mains cables to the respective terminal block. N for neutral, L for live wire, L1 for the maintained operation and the 

  for ground connection. The L1 wire can be connected to an external switch to control the maintained or non maintained operation of the luminaire. For permanent maintained operation use two wires to power the luminaire, N for neutral and L for live wire, and link the L and L1. The A and B contacts are used only if an optional module is connected. Refer to the modules manual for more information regarding connection.



ATTENTION!! Make sure that the ground cable is attached to the respective ground connector. Replace the removed parts in the previous steps.

## SURFACE MOUNTING ON A WALL (single sided)


(5) Install the included plastic bracket on the wall (figure 1). Remove the aluminum bracket from the luminaire and use the two supplied mounting screws to install the aluminum bracket to the plastic bracket (figure 2). Slide the luminaire to the aluminum bracket and use the bolt on the center (\*), to stabilize the luminaire (figure 2).


#### **CEILING MOUNTING (double sided)**

- ® Remove the aluminum bracket from the luminaire and install it with the included spacers, screws and plugs in the ceiling (page 3). Slide the luminaire to the aluminum bracket and use the bolt on the center (\*), to stabilize the luminaire (figure 4).
- 7 Power on the device at the end of the installation.


NOTE!! After finishing the installation you must power the luminaire at least for 24 hours for battery charging to perform the nominal autonomy.


(\*) First, hand tighten it and then, use pliers to tighten it little bit more (not all the way).






#### **Connection Diagramms**






LED MODULE CHARACTERISTICS							
	LLB-26/90-LLB-26/180	LLB-40/90-LLB-40/180	LLB-64/90-LLB-64/180				
Manufacturer	Olympia Electronics S.A						
Model Number	2405185	0204185	2605185+2705185				
Voltage Range	14 - 16.5VDC						
Nominal Power	4.5W	7.2W	11.7W				
Connections	Non reversible connection between main pcb and led module						
Temperature (tc)	45 °C max. across the board	45 °C max. across the board	50 °C max. across the board				

Page 3 from 6 923064003 09 003

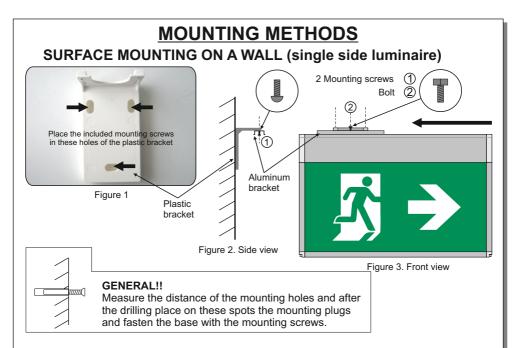

## SIDE WALL CLEARANCE

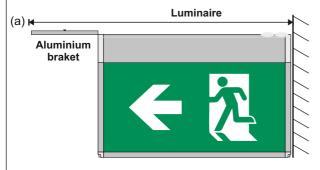


Depending on the size of the luminaire the distance from the side wall must be more than:

(a): LLB 26: 440mm LLB 40: 580mm

LLB 64: 820mm

# **CEILING MOUNTING (double side luminaire)**

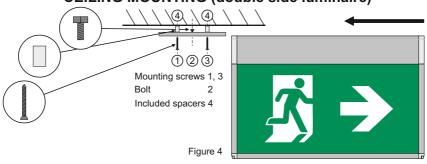

Page 4 from 6 923064003 09 003



FLAG MOUNTED ON A WALL (double side luminaire)

A-1135 SET, ONLY FOR LLB-26 (OPTIONAL AFTER REQUEST)



# **HANGING INSTALLATION (double side luminaire)**






# **INSTALLATION PICTOGRAMMS**

1. Unfasten the two screws of the luminaire and remove the top part of the luminaire.

2.Insert the pictogramm after removing the protective film from the back side.






3. Carefully fit the top aluminium cover and reinstall the retaining screws.

Page 5 from 6 923064003 09 003

### **Battery replacement process**





It can be done only by a competent person and after the mains interruption.

- ① Unfasten the two side cover screws and remove the plastic cap (with the indications) by sliding it gently to the right.
- ② Remove the old battery. Install the new one and place the connector as shown on the picture.
- Refit the plastic cap (with the indications) by sliding it gently to the left and fasten the removed screws in step 1.

WARNING!! Use a maximum torque of 0,9Nm to tighten the screws.

NOTE!! In case of battery replacement the used battery must be replaced with a new one of the same type, by the manufacturer or by a competent person.

**NOTE: LED= Light Emitting Diode** 

#### LABELING EXPLANATION:

X: Self contained

1: Maintained (\*)

A: Including test device

E: With non-replaceable lamp(s) and/or battery

F: Automatic test gear complying with IEC

61347-2-7 denoted EL-T **G:** Internally illuminated

**90:** 1.5 hour duration **180:** 3 hours duration

(\*) <u>Maintained operation:</u> The luminaire lights its illumination source, when it is powered by the mains power supply or not.

Note!! If a module will be used (except the fault relay module), then the installer should fill in, on the specification label, the letters **B C**.

X 1 A E F G 9 0

#### WARRANTY

Olympia Electronics guarantees the quality, condition and operation of the goods. The period of warranty is specified in the official catalogue of Olympia Electronics and also in the technical leaflet, which accompanies each product. This warranty ceases to exist if the buyer does not follow the technical instructions included in official documents given by Olympia Electronics or if the buyer modifies the goods provided or has any repairs or re-setting done by a third party, unless Olympia Electronics has fully agreed to them in writing. Products that have been damaged can be returned to the premises of our company for repair or replacement, as long as the warranty period is valid. Olympia Electronics reserves the right to repair or to replace the returned goods and to or not charge the buyer depending on the reason of defection. Olympia Electronics reserves the right to charge or not the buyer the transportation cost.

#### HEAD OFFICE

72nd km. O.N.R. Thessaloniki-Katerini P.C. 60300 P.O. Box 06 Eginio Pierias Greece

www.olympia-electronics.gr info@olympia-electronics.gr

Page 6 from 6 923064003 09 003